



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Regency Plus, Inc.
1024 Locust Gap Highway
Mount Carmel, PA 17851

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "5108" White PVC Fixed Window -- L.M.I.

APPROVAL DOCUMENT: Drawing No. RPLS0060, titled "Impact 5108 Series Fixed Window" sheets 1 through 5 of 5, dated 09/16/08, with revision C dated 12/07/13, prepared by PTC, LLC, signed and sealed by Robert J. Amoroso, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA# 12-0223.07 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



MP
1/7/14

NOA No. 13-0814.02
Expiration Date: January 28, 2019
Approval Date: January 16, 2014
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **RPLS0060**, titled "Impact 5108 Series Fixed Window" sheets 1 through 5 of 5, dated 09/16/08, with revision C dated 12/07/13, prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of a series 5108 fixed window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-110-11363-1**, dated 05/15/08, signed and sealed by Harold E. Rupp, P.E.
(Submitted under **NOA#08-1021.04**)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis prepared by PTC, LLC, complying with FBC-2007, dated 09/15/08, signed and sealed by Paul E. Winter, P.E.
(Submitted under previous **NOA#12-0223.07**)
2. Glazing complies with **ASTM E1300-04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **13-0129.27** issued to **E.I. DuPont DeNemours & Co., Inc.** for their "**DuPont Butacite® PVB Interlayer**" dated 04/11/13, expiring on 12/11/16.
2. Notice of Acceptance No. **12-1120.02**, issued to **Royal Window and Door Profiles, Plant 13**, for their **White Rigid PVC Exterior Extrusions**, approved on 02/28/13, expiring on 02/28/18.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 13-0814.02

Expiration Date: January 28, 2019
Approval Date: January 16, 2014

Regency Plus, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC-2010**, and of no financial interest, dated February 07, 2012, signed and sealed by Robert J. Amoruso, P.E.
2. Laboratory code compliance statement, issued by National Certified Testing Laboratories for Test Report No. **NCTL-110-11363-1**, dated 05/15/08, signed and sealed by Harold E. Rupp, P.E.
(Submitted under NOA#08-1021.04)

G. OTHER

1. Notice of Acceptance No. **12-0223.07**, issued to Regency Plus, Inc. for their Series "5108" White PVC Fixed Window – L.M.I., approved on 05/19/12 and expiring on 01/28/14.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 13-0814.02

Expiration Date: January 28, 2019
Approval Date: January 16, 2014

REGENCY PLUS, INC.

IMPACT 5108 SERIES FIXED WINDOW

INSTALLATION ANCHORAGE DETAILS

GENERAL NOTES:

1. THE PRODUCT ANCHORAGE SHOWN HEREIN IS DESIGNED TO COMPLY WITH THE 2007 AND 2010 FLORIDA BUILDING CODE (FBC) INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ) AT THE DESIGN PRESSURES STATED HEREIN.
2. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED TEST REPORT # NCTL-110-11363-1 DATED 05/15/08 AND ASSOCIATED LABORATORY STAMPED DRAWINGS AND WERE TESTED IN ACCORDANCE WITH CURRENT DADE COUNTY PROTOCOLS.
3. THE PRODUCT HAS BEEN EVALUATED FOR CONFORMANCE TO THE STANDARDS LISTED IN THE 2007 AND 2010 FLORIDA BUILDING CODE (FBC) AND IS IN COMPLIANCE WITH SAID STANDARDS, INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ) REQUIREMENTS.
4. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE STRUCTURE IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
5. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
6. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, THEN THE BUILDING OFFICIAL MAY ELECT ONE OF THE FOLLOWING OPTIONS:
 - A. OUTSIDE HVHZ: REQUIRE THAT A LICENSED ENGINEER OR ARCHITECT PREPARE AND SUBMIT SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
 - B. INSIDE HVHZ: REQUIRE THAT A ONE-TIME SITE SPECIFIC APPROVAL BE APPLIED FOR AND OBTAINED FROM THE MIAMI-DADE COUNTY PRODUCT CONTROL DIVISION.

DESIGN PRESSURE RATING (PSF)	IMPACT RATING
±55.0 PSF	LARGE MISSILE IMPACT

7. THIS PRODUCT DOES NOT REQUIRE THE USE OF A DADE COUNTY APPROVED IMPACT SYSTEM.
8. WINDOW FRAME MATERIAL: RIGID VINYL PVC PER NOA # 12-1120.02.
9. GLASS MEETS THE REQUIREMENTS OF ASTM E1300-04e1. SEE SHEET 3 FOR GLAZING DETAIL.
10. DESIGNATION "O" STANDS FOR THE FOLLOWING:
O: FIXED PANEL
11. A 1/3 INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS NOT USED IN THE DESIGN OF THE PRODUCT(S) SHOWN HEREIN. WIND LOAD DURATION FACTOR (Cd = 1.6) HAS BEEN USED FOR WOOD ANCHOR DESIGN.
12. EACH WINDOW ASSEMBLY SHALL BE LABELED WITH A PERMANENT LABEL AND/OR STAMP WITH THE EXTRUDER CODE AND "MDCA".

INSTALLATION NOTES:


1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM SIZE IS 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
4. FOR INSTALLATION INTO WOOD FRAMING, USE #12 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT. MINIMUM EDGE DISTANCE IS 3/4 INCHES.
5. FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE / MASONRY, OR DIRECTLY INTO CONCRETE / MASONRY, USE 3/16 INCH ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT. MINIMUM EDGE DISTANCE IS 2 1/2 INCHES.
6. INSTALLATION ANCHORS ARE TO BE LOCATED THROUGH PERIMETER OF NAILING FIN WHEN APPLICABLE.
7. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING.
8. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
9. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
10. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
11. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - A. WOOD - SOUTHERN YELLOW PINE - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3192 psi.
 - C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90.

TABLE OF CONTENTS		
SHEET	REV.	SHEET DESCRIPTION
1	B	GENERAL NOTES, INSTALLATION NOTES & D.P. CHART
2	B	ELEVATION AND ANCHOR LAYOUTS
3	B	HORIZONTAL & VERTICAL SECTIONS & GLAZING DETAIL - OPT. INSTALLATION
4	B	HORIZONTAL & VERTICAL SECTIONS - PARTING STOP INSTALLATION
5	B	COMPONENTS, BILL OF MATERIALS & CORNER SECTION


PROJECT #413-1019			
REV	DESCRIPTION	DATE	BY
C	REVISE PVC MANUF. AND NOA NO.	12/7/13	RJA
B	UPDATE TO 2010 FBC	02/07/12	TJH
A	PER MIAMI-DADE 11-15-08	12/2/08	SMC

REGENCY PLUS, INC. 1024 LOCUST GAP HIGHWAY MT. CARMEL, PA 17851		DATE: 09/18/08	
IMPACT 5108 SERIES FIXED WINDOW GENERAL NOTES, INSTALLATION NOTES & D.P. CHART		DRAWING NO: RPLS0060	
PTC Product Design Group, LLC PO Box 520775, Longwood, FL 32752-0775 321-690-1788 info@ptc-corp.com FBPE Cert. of Auth. No. 25935		SHEET: 1 OF 5	


Robert J. Amoroso, P.E.
Florida P.E. No. 49752

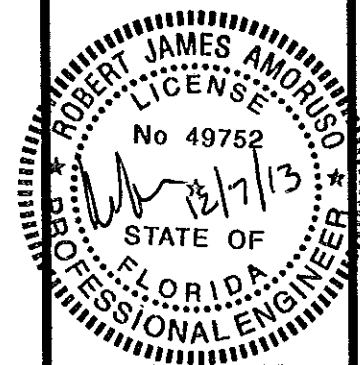


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 13-0814-92
Expiration Date: Jan. 28, 2019
By: [Signature]
Miami Dade Product Control

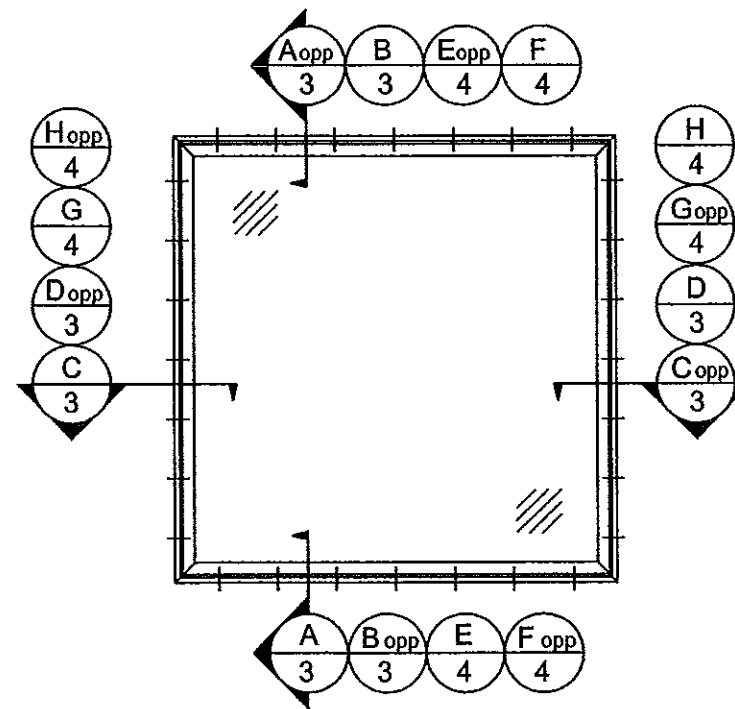

ELEVATION
EXTERIOR VIEW

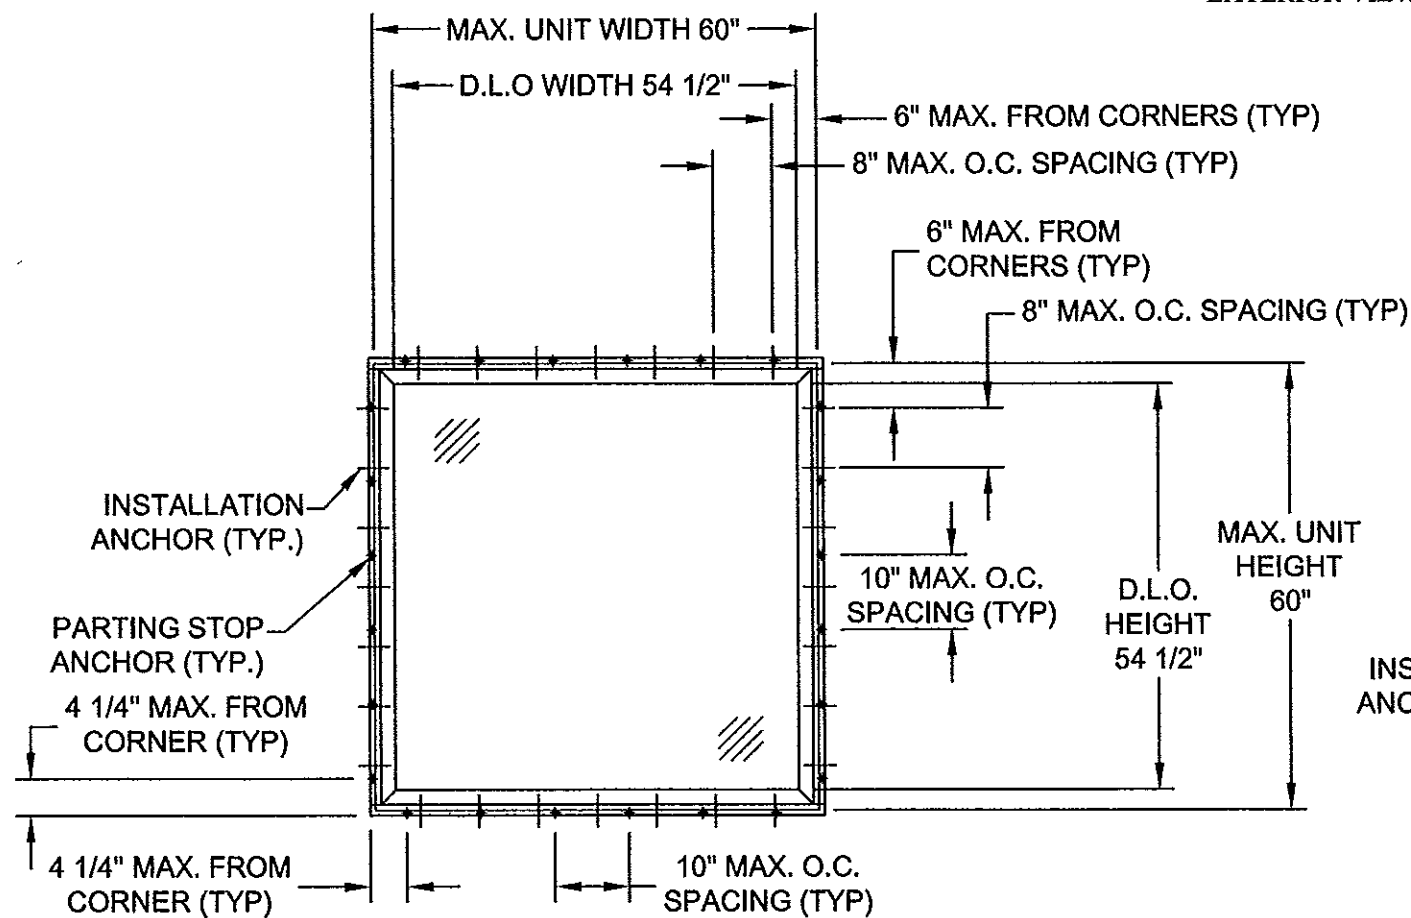

ANCHOR LAYOUT
PARTING STOP INSTALLATION
EXTERIOR VIEW

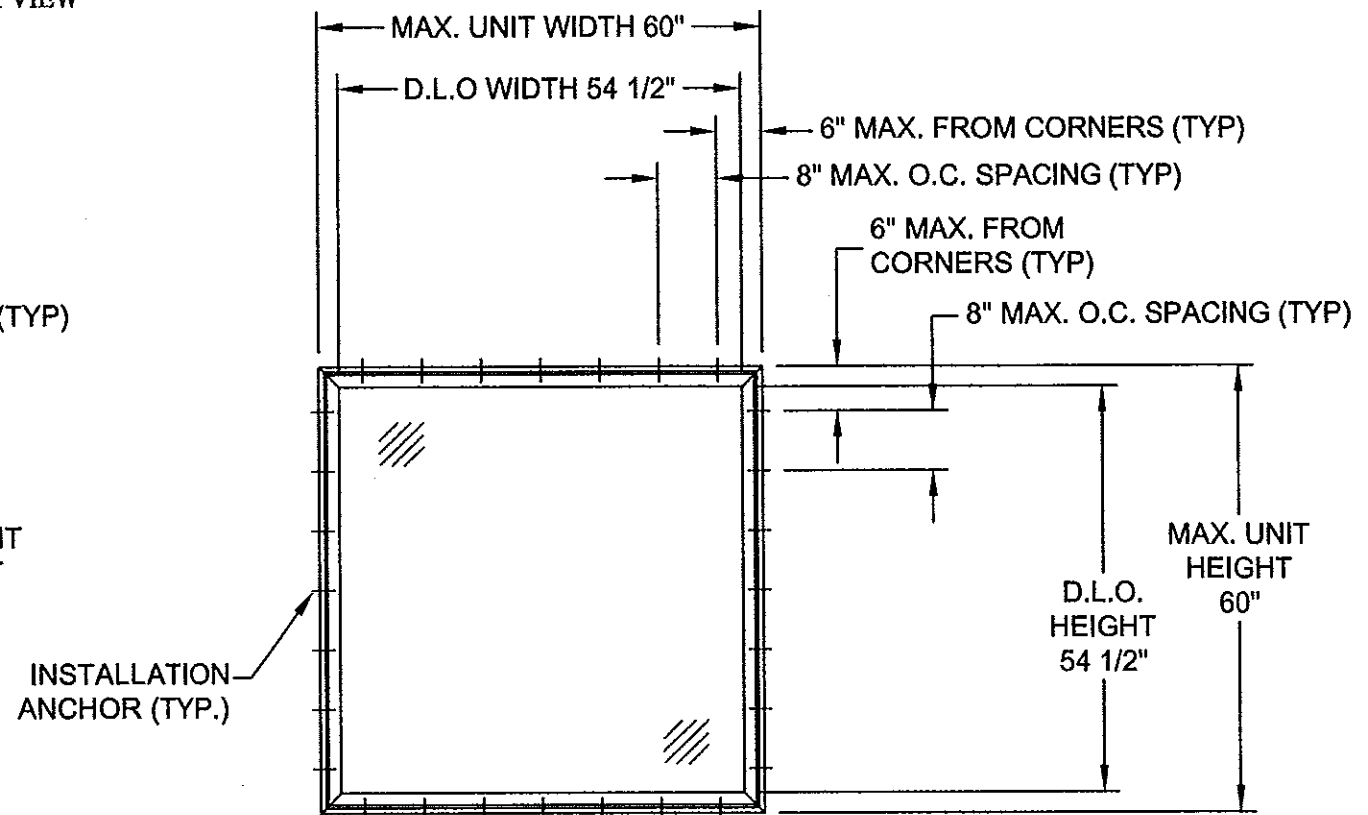


ANCHOR LAYOUT
OPTIONAL INSTALLATION
EXTERIOR VIEW


PROJECT #413-1019		RJA	12/7/13	TJH	SMC	BY
C	REVISE PVC MANUF. AND NOA NO.	12/7/13	02/07/12	12/2/08	DATE	REV
B	UPDATE TO 2010 FBC	02/07/12	PER MIAMI-DADE 11-15-08	DESCRIPTION		
A						

REGENCY PLUS, INC. 1024 LOCUST GAP HIGHWAY MT. CARMEL, PA. 17851		DATE	09/16/08	DRAWING NO.	RPLS0060	SHEET	2 OF 5
IMPACT 5108 SERIES FIXED WINDOW ELEVATION AND ANCHOR LAYOUTS		DRAWN BY:	BB	SCALE:	N.T.S.	REV:	C
PTC Product Design Group, LLC PO Box 520775, Longwood, FL 32752-0775 321-690-1788 Info@ptc-corp.com FBPE Cert. of Auth. No. 25935							


Robert J. Amoroso, P.E.
Florida P.E. No. 49752

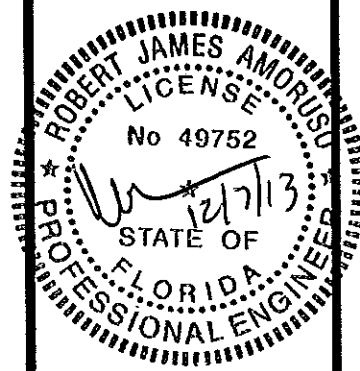

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 13-0814-02
Expiration Date Jan 28, 2019
By *Manuel Perez*
Miami Dade Product Control

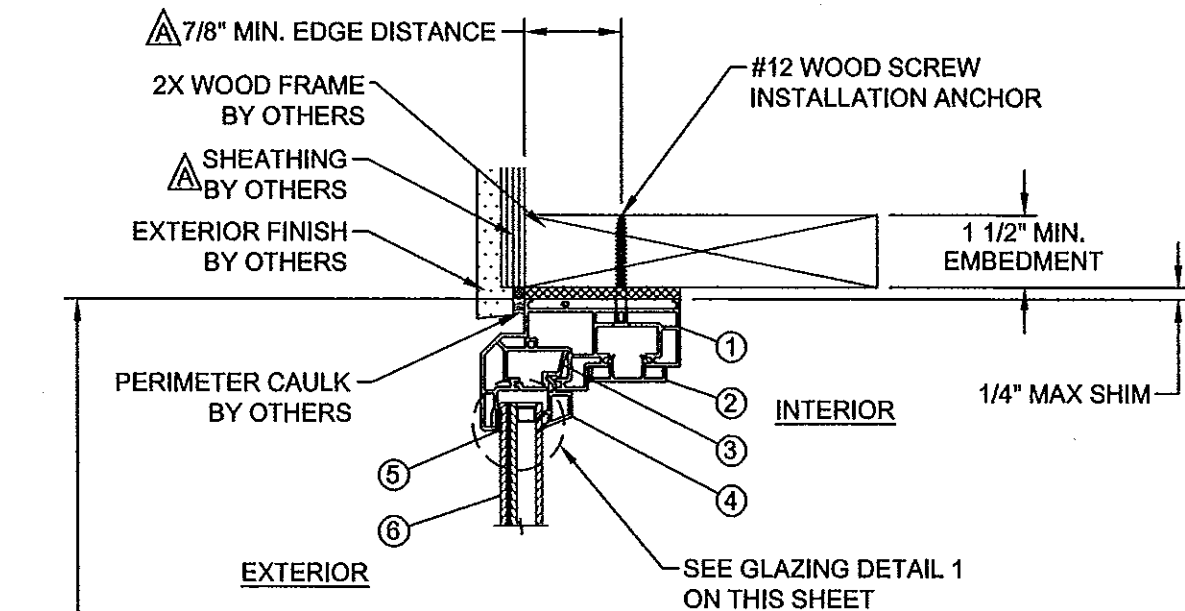


B VERTICAL SECTION
OPTIONAL INSTALLATION
WOOD FRAME SUBSTRATE

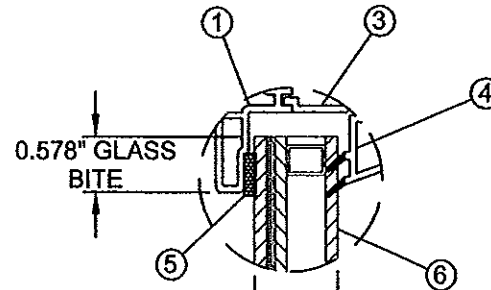


7/8" O.A. INSULATING GLASS CONSISTING OF:
1/8" ANNEALED GLASS, 0.090" INTERLAYER
BY DUPONT, 1/8" ANNEALED GLASS,
AIR SPACE, 1/8" INTERIOR TEMPERED GLASS

GLAZING DETAIL 1


MAX. O.A.
FRAME
HEIGHT

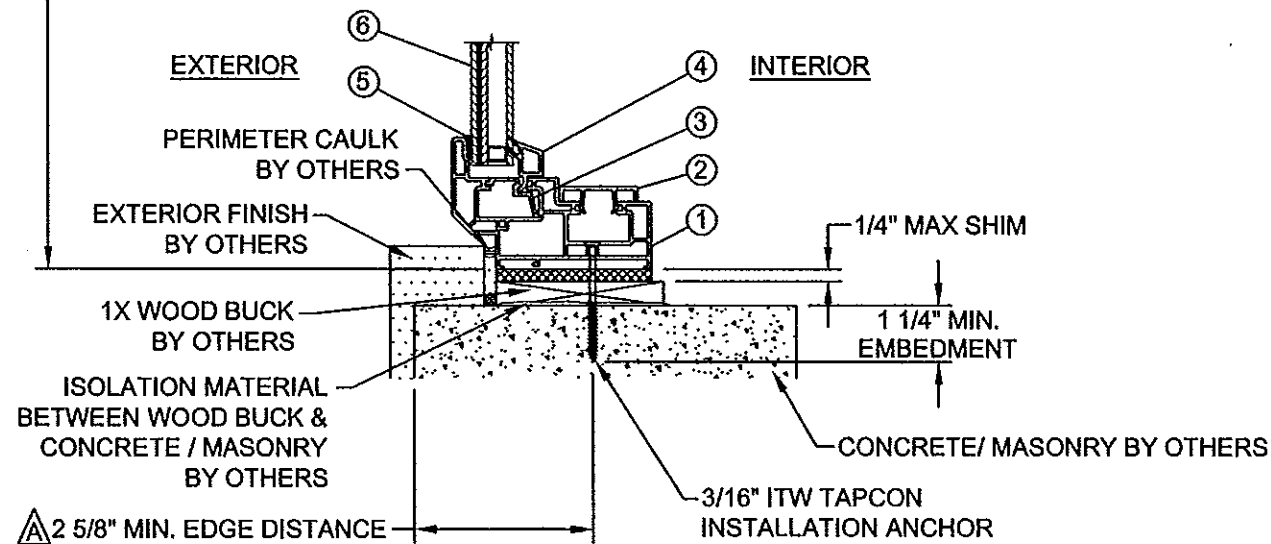

A VERTICAL SECTION
OPTIONAL INSTALLATION
CONCRETE SUBSTRATE

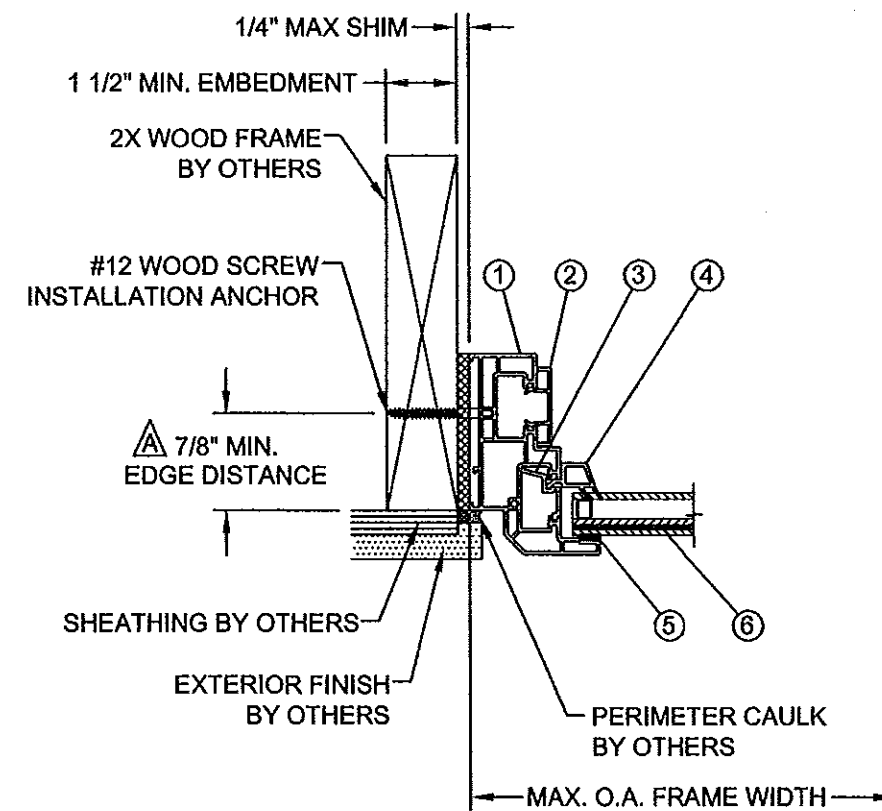

C HORIZONTAL SECTION
OPTIONAL INSTALLATION
WOOD FRAME SUBSTRATE

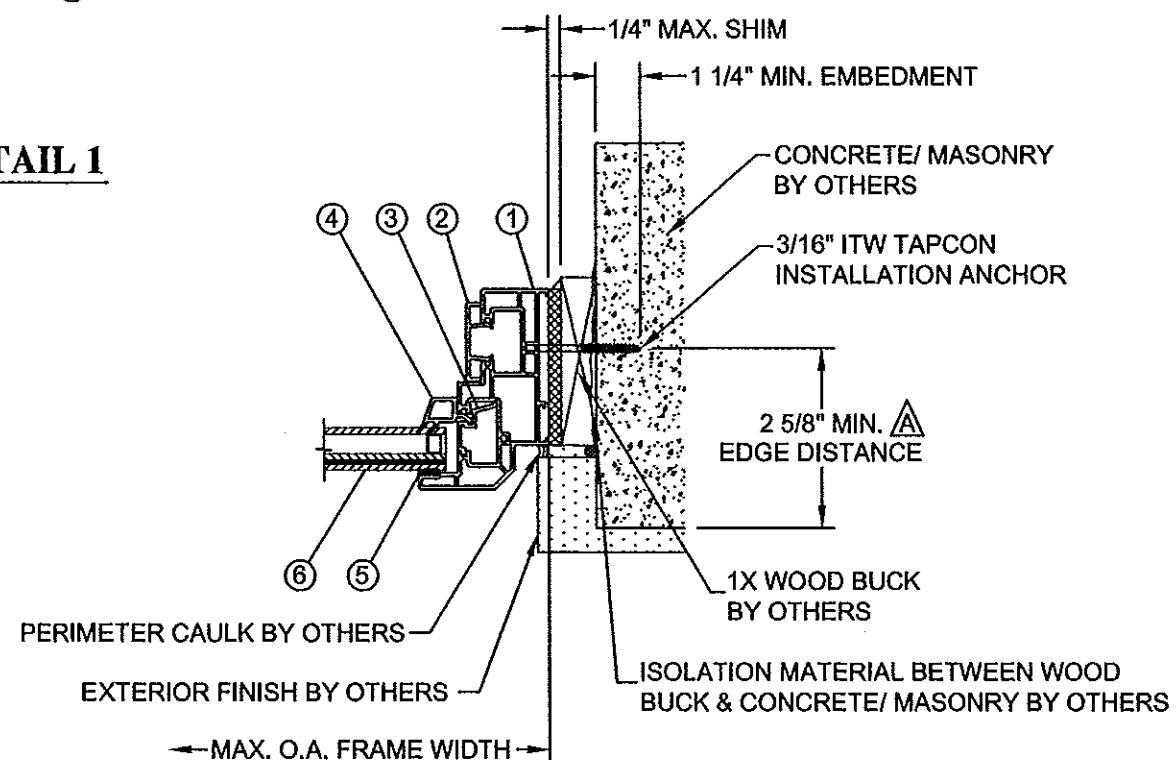


D HORIZONTAL SECTION
OPTIONAL INSTALLATION
CONCRETE / MASONRY SUBSTRATE

PROJECT #413-1019	RJA	TJH	SMC	BY
REVISION	12/7/13	02/07/12	12/2/08	DATE
REVISE PVC MANUF. AND NOA NO.	C	B	A	REV
UPDATE TO 2010 FBC				
PER MIAMI-DADE 11-15-08				
DESCRIPTION				


REGENCY PLUS, INC. 1024 LOCUST GAP HIGHWAY MT. CARMEL, PA 17851	DATE: 09/16/08	DRAWING NO: RPLS0060	SHEET: 3 OF 5
TITLE: IMPACT 5108 SERIES FIXED WINDOW HORIZONTAL & VERTICAL SECT. & GLAZING DETAIL OPT. INSTALL	DRAWN BY: BB	SCALE: N.T.S.	REV: C
PTC Product Design Group, LLC PO Box 520775, Longwood, FL 32752-0775 321-690-1788 info@ptc-corp.com FBPE Cert. of Auth. No. 25935			

Robert J. Amoroso, P.E.
Florida P.E. No. 49752

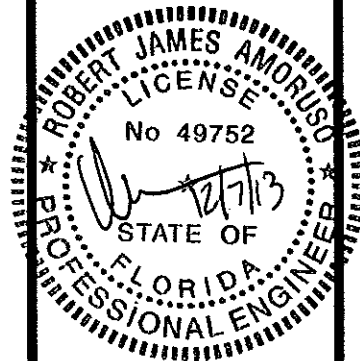


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 13-081402
Expiration Date Jan 15, 2017


By *M. Dade*
Miami Dade Product Control

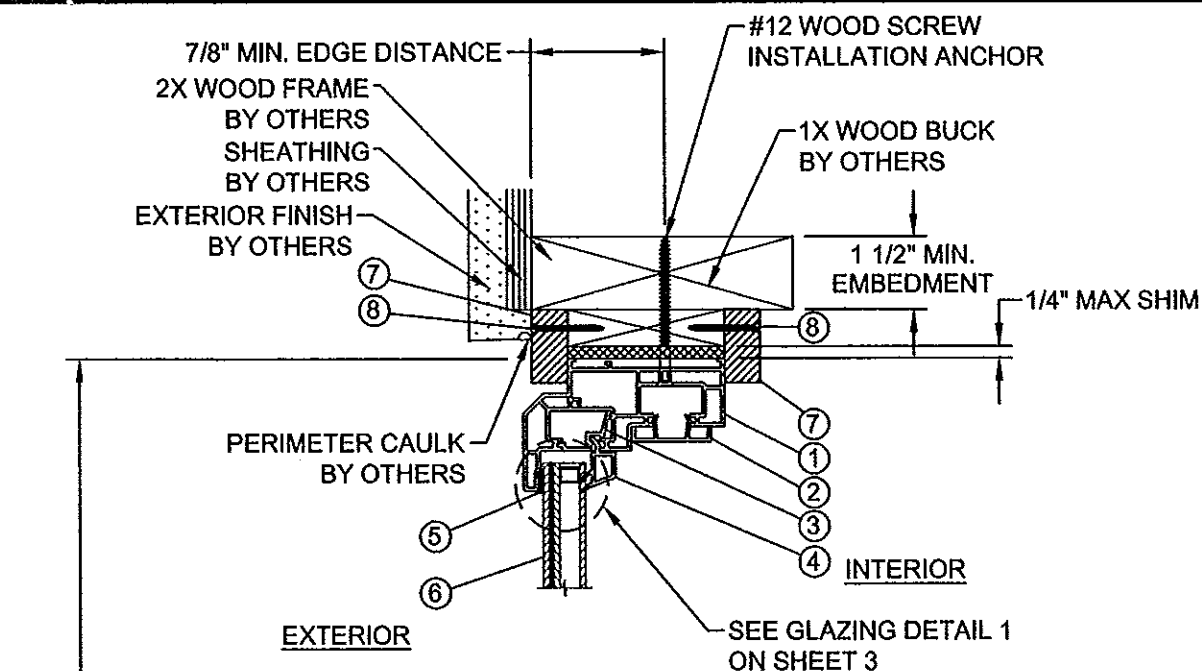


F VERTICAL SECTION
PARTING STOP INSTALLATION
WOOD FRAME SUBSTRATE

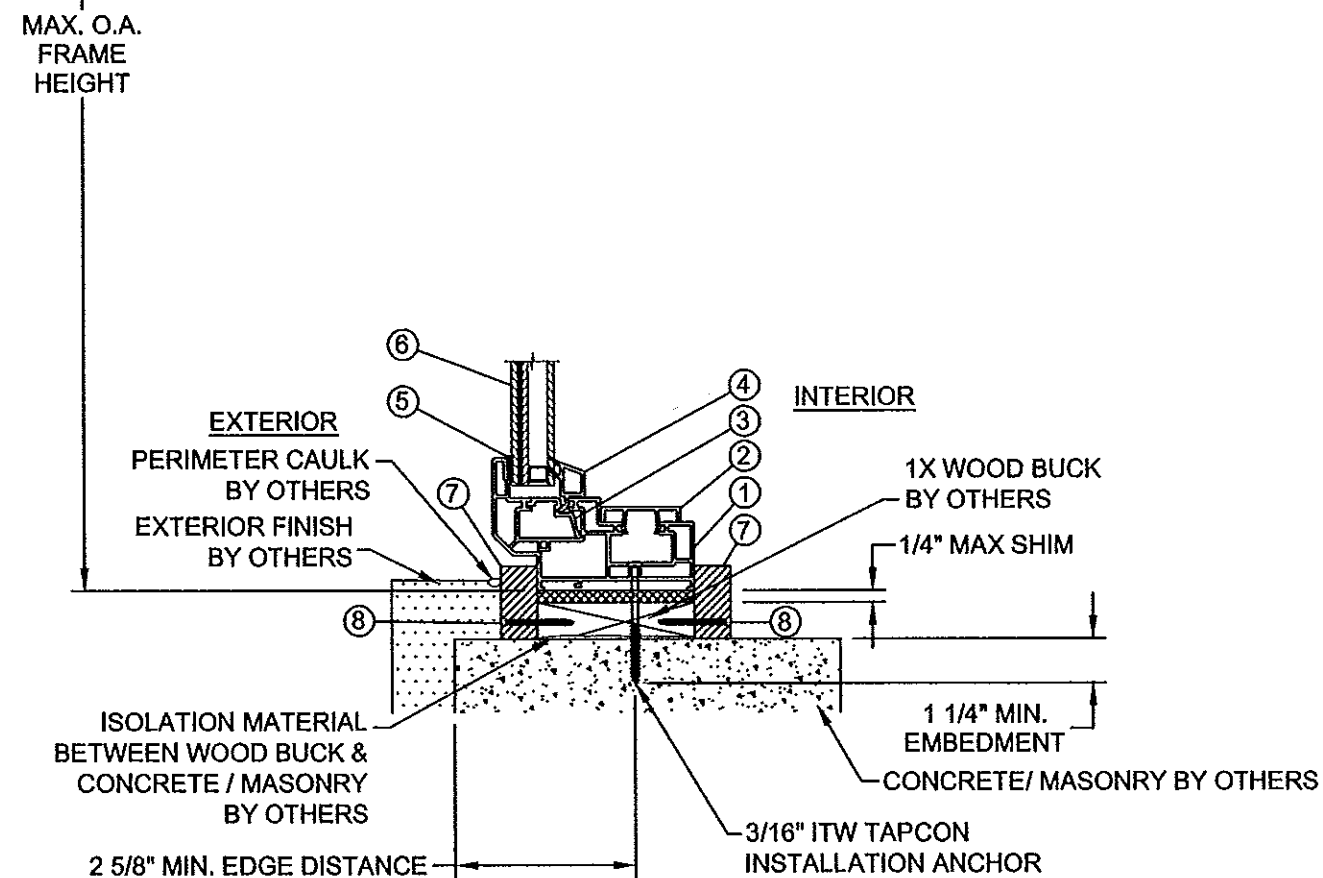

E VERTICAL SECTION
PARTING STOP INSTALLATION
CONCRETE SUBSTRATE

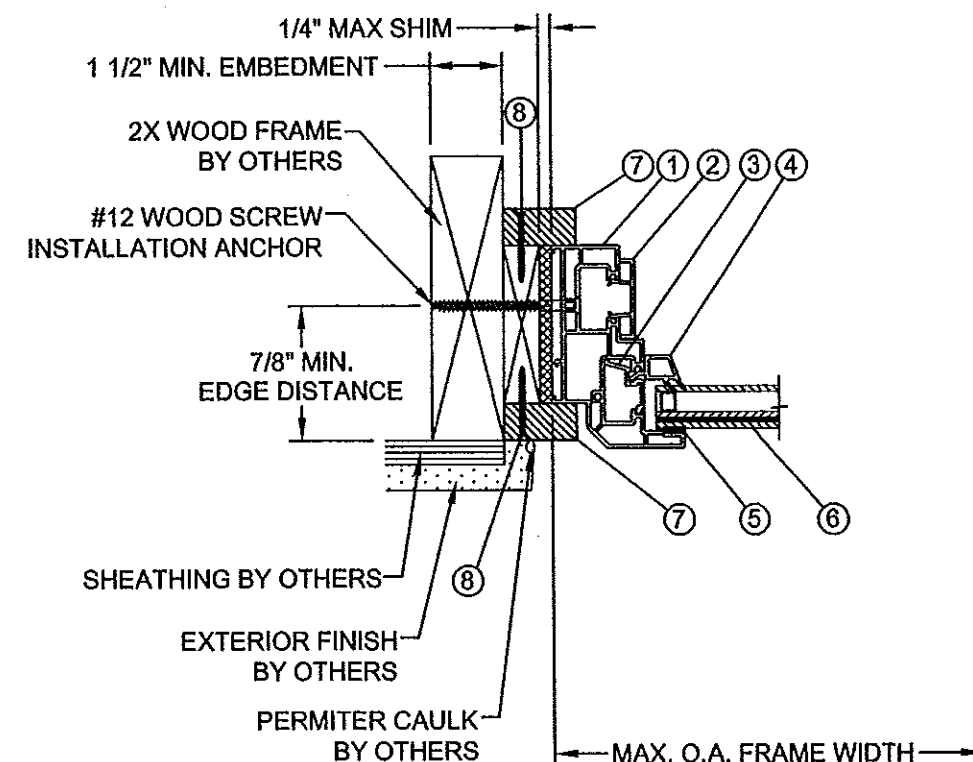

G HORIZONTAL SECTION
PARTING STOP INSTALLATION
WOOD FRAME SUBSTRATE

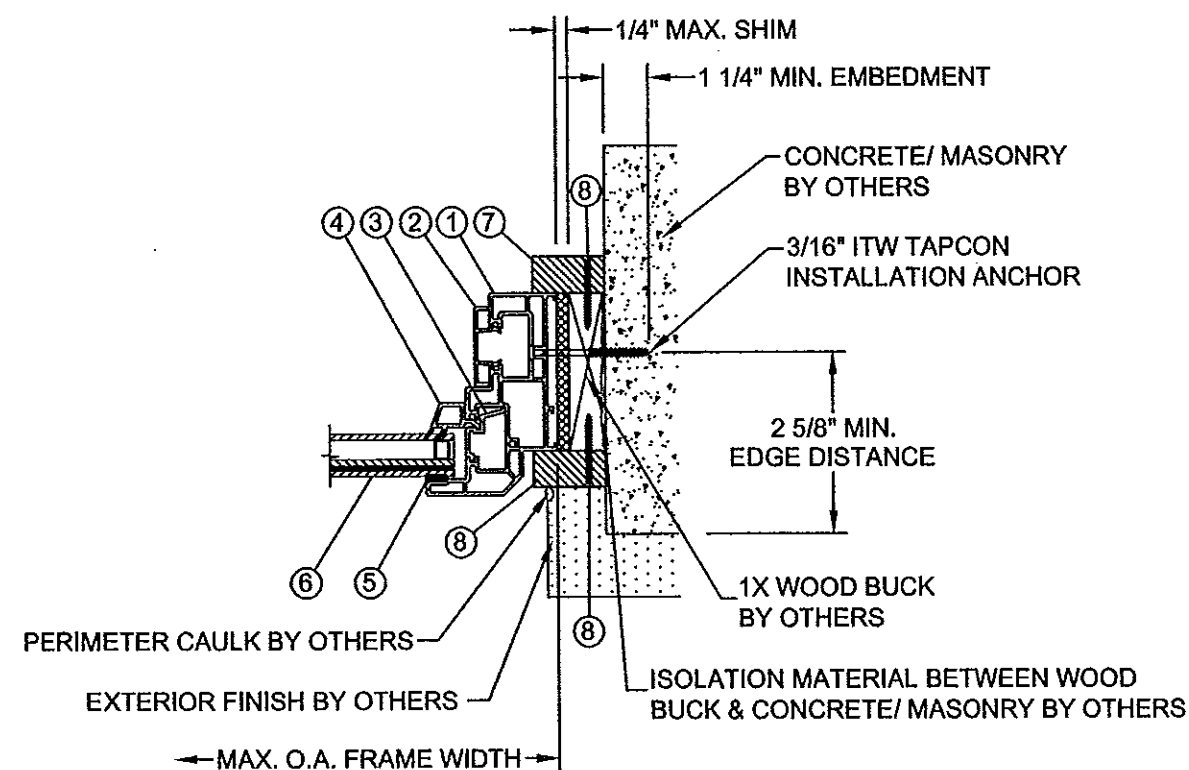


H HORIZONTAL SECTION
PARTING STOP INSTALLATION
CONCRETE / MASONRY SUBSTRATE



PROJECT #413-1019	RJA	TJH	SMC	BY
REVISE PVC MANUF. AND NOA NO.	12/7/13	02/07/12	12/2/08	DATE
UPDATE TO 2010 FBC				
PER MIAMI-DADE 11-15-08				
DESCRIPTION				

REGENCY PLUS, INC.	DATE:	09/16/08	DRAWING NO:	RPLS0060	SHEET:	4 OF 5
1024 LOCUST GAP HIGHWAY	BB		N.T.S.			
MT. CARMEL, PA 17851	SCALE:					
IMPACT 5108 SERIES FIXED WINDOW	REV:	C				
HORIZONTAL & VERTICAL SECTIONS - PARTING STOP INSTALL.						
PTC Product Design Group, LLC						
PO Box 520775, Longwood, FL 32752-0775						
321-590-1788 Info@ptc-corp.com						
FBPE Cert. of Auth. No. 25935						

Robert J. Amoroso, P.E.
Florida P.E. No. 49752

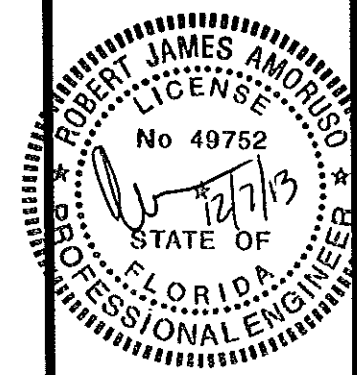


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 13-0814-02
Expiration Date Jan 15, 2014
By *W. Amoroso*
Miami Dade Product Control

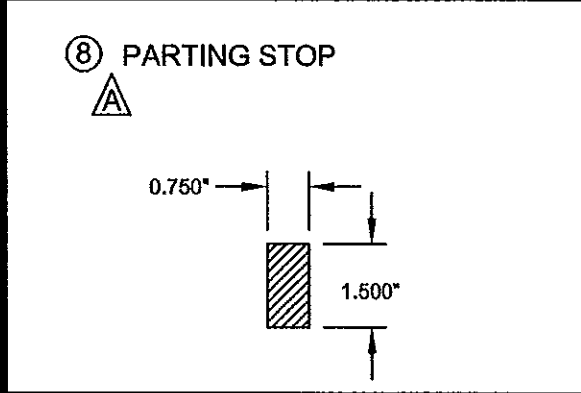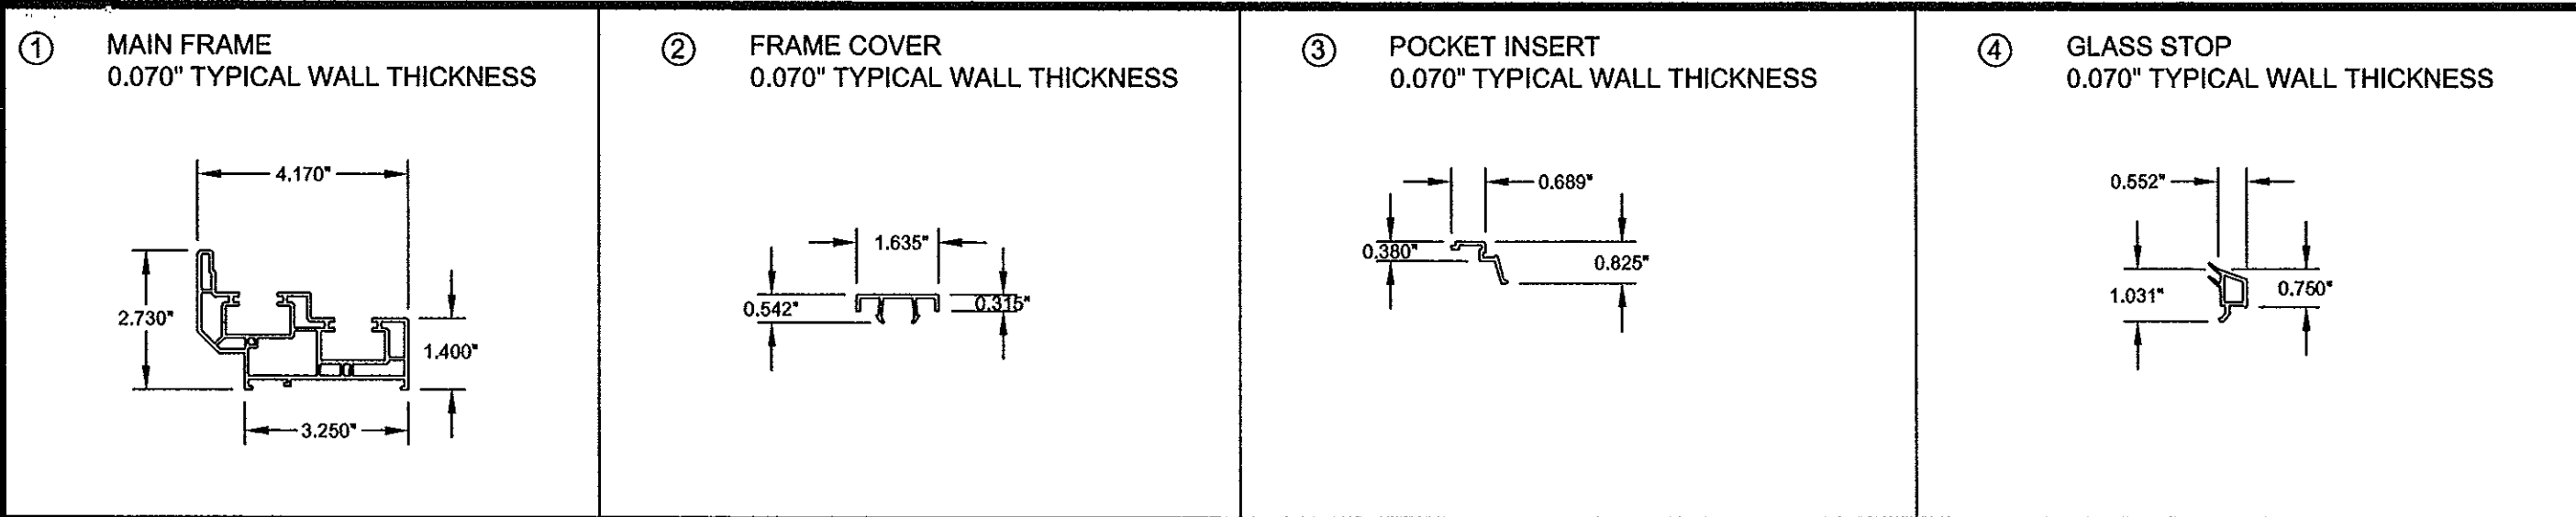

SYM #	PART #	DESCRIPTION	MATERIAL	MANUFACTURER
△ 1	IV-1060	MAIN FRAME	WHITE RIGID PVC	** RWDP △
△ 2	IV-1070	FRAME COVER	WHITE RIGID PVC	** RWDP △
△ 3	IV-1079	POCKET INSERT	WHITE RIGID PVC	** RWDP △
△ 4	IV-1103	GLASS STOP	WHITE RIGID PVC	** RWDP △
5	IV-1070	SIKA FLEX 552 SILICONE BACK BEDDING	SILICONE	SIKA
△ 6	----	7/8" O.A. INSULATING GLASS CONSISTING OF: 1/8" INTERIOR TEMPERED GLASS, AIR SPACE, 1/8" ANNEALED GLASS, 0.090" INTERLAYER BY DUPONT, 1/8" ANNEALED GLASS	GLASS	----
△ 7	----	1 1/2" X 3/4" PARTING STOP	WOOD	----
△ 8	----	#6 X 1 5/8" SCREW	STEEL	----

△ ** RWDP: ROYAL WINDOWS
AND DOOR PROFILES, PLANT
NO. 13 (NOA NO. 12-1120.02).

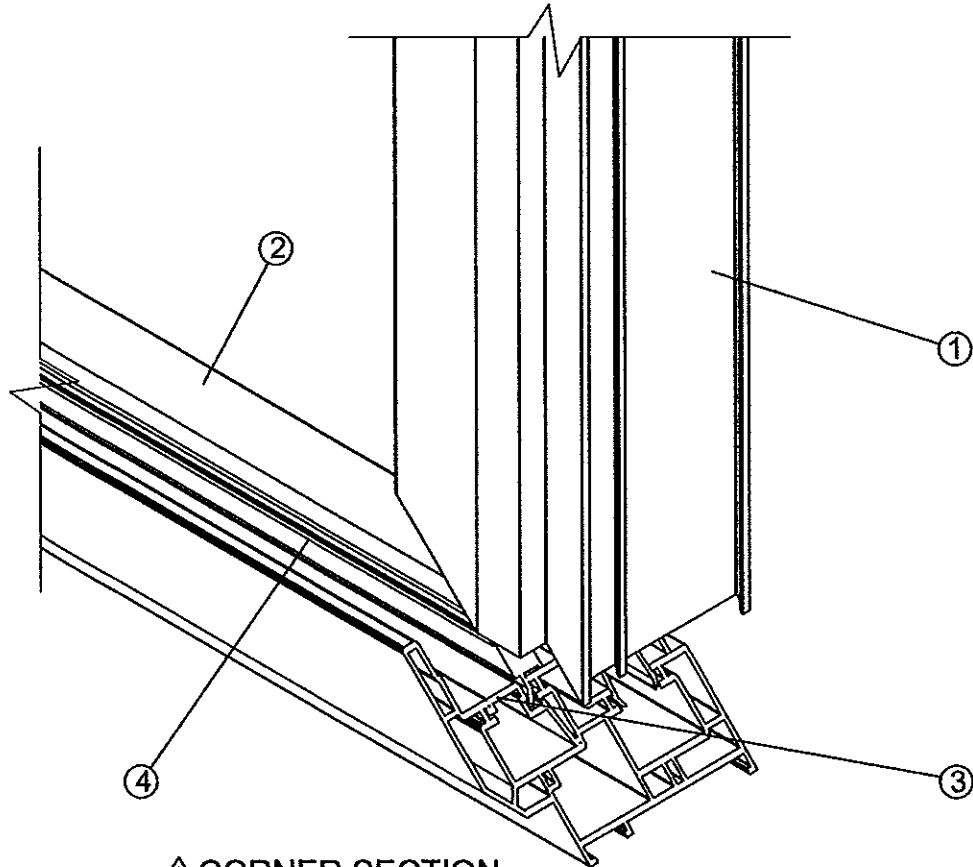

△ CORNER SECTION

PROJECT #413-1019

REV	A	PER MIAMI-DADE 11-15-08	DATE	12/2/08	BY	SMC
REV	B	UPDATE TO 2010 FBC	DATE	02/07/12	BY	TJH
REV	C	REVISE PVC MANUF. AND NOA NO.	DATE	12/7/13	BY	RJA

REGENCY PLUS, INC.
1024 LOCUST GAP HIGHWAY
MT. CARMEL, PA 17851

TITLE: IMPACT 5108 SERIES FIXED WINDOW
COMPONENTS, BILL OF MATERIALS & CORNER SECTION

DATE: 09/16/08
DRAWN BY: BB
SCALE: N.T.S.
DRAWING NO: RPLS0060
REV: C
SHEET: 5 OF 5

PTC Product Design Group, LLC
PO Box 520775, Longwood, FL 32752-0775
321-690-1788 info@ptc-corp.com
FBPE Cert. of Auth. No. 25935

Robert J. Amoruso, P.E.
Florida P.E. No. 49752

ROBERT JAMES AMORUSO
LICENSE
No 49752
12/7/13
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 13-0814.02
Expiration Date 12/28/2019
By: [Signature]
Miami Dade Product Control